



TECHNICAL DATA
CABLE GLAND TYPE
INGRESS PROTECTION
PROCESS CONTROL SYSTEM

: T3CDSX
: IP66, IP68, NEMA 4X, DELUGE TO DT501-91
: ISO 9001
: ISO / IEC 80079-34:2011

EXPLOSIVE ATMOSPHERES CLASSIFICATION

ATEX CERTIFICATION NO

: CML 18ATEX1326X, CML 18ATEX4318X

ATEX CERTIFICATION CODE

: II 2G, II 1D, Ex db IIC Gb, Ex eb IIC Gb, Ex ta IIC Da, II 3G Ex nr IIC Gc,

UKEX CERTIFICATION NO

: I1 M2, Ex db I Mb, Ex eb I Mb

UKEX CERTIFICATION CODE

: CML 21UKEX1258X, CML 21UKEX4259X

IECEx CERTIFICATION NO

: II 2G, II 1D, Ex db IIC Gb, Ex eb IIC Gb, Ex ta IIC Da, II 3G Ex nr IIC Gc,

IECEx CERTIFICATION CODE

: I1 M2, Ex db I Mb, Ex eb I Mb

CCSAus CERTIFICATION NO

: IECEx CML 18.0183X

CSA US CERTIFICATION CODE*

: Ex db IIC Gb, Ex eb IIC Gb, Ex nr IIC Gc, Ex ta IIC Da, Ex db I Mb, Ex eb I Mb

c CSA CERTIFICATION CODE

: 1310517X

UL CERTIFICATION NO

: Class II Div 2, Groups E, F and G, Class III,

UL CERTIFICATION CODE

: Class I Zone 1 ATEX e II, Class I Zone 2 2AEx nR II, Enclosure Type 3, 4 and 4X, OIL RES II

: Class I, Div 2, Groups A, B, C and D, Class II Div 2, Groups E, F and G, Class III,

: Ex d IIC, Ex e II, Ex nr II, Enclosure Type 3, 4 and 4X, OIL RES II

: E256367

: Class I Zone 1, ATEX e II

*T3CDSX can be used in Class 1, Division 2 Locations for non-explosionproof applications in accordance with Article 501 of the NEC Code

INSTALLATION INSTRUCTIONS

Installation should only be performed by a competent person using the correct tools. Read all instructions before beginning installation.

CERTIFICATION CONDITIONS

ATEX, UKEX, IECEx & UL
1. The T3* Type cable glands shall not be used to terminate on braided cables in group I applications.

2. The glands when used for terminating braided cables are only suitable for fixed installations. Cables must be effectively clamped to prevent pulling or twisting.

3. The interface between a cable entry device and its associated enclosure / cable entry will require additional sealing to achieve ingress protection (IP) ratings higher than IP54. The minimum protection level is IP54 for explosive gas atmospheres and IP6X for explosive dust atmospheres. Parallel threads (and tapered threads when using a non-threaded entry) require a CMP sealing washer or integral O-ring face seal (where available) to maintain IP66, 67 and 68 (when applicable). It is the installer's responsibility to ensure the IP rating is maintained at the interface.

Note: When fitted to a threaded entry, all tapered threads will automatically provide an ingress protection rating of IP66.

4. A CMP earth tag should be used when it is necessary to provide an earth bond connection. CMP earth tags have been independently tested to comply with Category B rating specified in IEC 62444 (there are no ratings stated in IEC 60079-0). Ratings are shown in the associated table. CMP earth tags slip over the cable gland or accessory entry thread from inside/outside the enclosure and must be secured with a locknut (if fitted internally).

5. Metric entry threads comply with ISO 965-1 and ISO 965-3 with a 6g tolerance as required by IEC 60079-1:2014. The CMP standard metric thread pitch is 1.5mm for threads up to M75, and 2.0mm from M90 and above. Special thread pitches between 0.7 – 2.0mm are available on all products on request. See certificate for details of other thread types. NPT threads are in accordance with ASME B1.20.1-2013 gauging to Cl 3.2 for external threads. For details of other thread types refer to IECEx certificate.

6. Enclosures must be strong enough to support the cable and cable gland assembly. The enclosure surface finish must be smooth and flat to facilitate sealing with an O-ring or Entry Thread Sealing Washer for the required IP rating.

7. Enclosure walls must be sufficiently strong enough to support the cable and cable gland assembly. Enclosure entries shall be perpendicular. Any draft angles from the casting/moulding process should have a perpendicular flat spot machined to facilitate sealing with an O-ring or Entry Thread Sealing Washer.

8. CMP Products recommends that when using the cable gland with a through-hole, the hole must be circular, free of burrs and the diameter no larger than 0.7mm above the thread major diameter. A suitable CMP Products locknut shall be used to secure the product. See CMP Products catalogue for locknut options.

9. Cable glands do not have any serviceable parts and are therefore not intended to be repaired.

1. Cable gland connectors material may be of brass, aluminum or stainless steel.

2. Connectors with metric entry threads are only suitable for Areas Classified in ZONES unless fitted with an approved Metric to NPT thread conversion adaptor.

3. According to US (NEC) wiring method for the types of cables that can be used in Class I Zone 1 and 2 Classified Areas, should be in accordance of NFPA-70 installation wiring method restrictions.

1. Cable gland connectors' material may be of brass, aluminum or stainless steel.

2. These glands are not suitable for use with flameproof enclosures installed in Group IIC atmospheres, which have a volume greater than 2000 cc (2 Litre). These Glands are for use with Certified Marine Shipboard metal braided cables constructed according to CSA Std. 245 and IEEE45/IEC60092-353 Standards, or Certified equivalent), for use on Shipboards and Offshore Rigs/platforms only.

4. "Triton CDS" cable gland connectors when installed into Class I, Division 2 Classified Areas, are not suitable to be interfaced with an explosion proof enclosure containing arcing and sparking devices, unless installed in conjunction with an approved explosion proof sealing fitting.

CSA us

c CSA

CMP Earth Tag Size	Short Circuit Ratings Symmetrical Fault Current (kA) for 1 second
20	3.06
25	4.06
32	5.40
40	7.20
50	10.40
63	10.40
75	10.40

ACCESSORIES

The following accessories are available from CMP Products, as optional extras, to assist with fixing, sealing and earthing: Locknut, Earth Tag, Serrated Washer, Entry Thread (I.P) Sealing Washer, Shroud

CMP Products Limited on its sole responsibility declares that the equipment referred to herein conforms to the requirements of the ATEX Directive 2014/34/EU and UK statutory requirements SI 2016 No. 1107 (as amended). This is shown in the following harmonised/designated standards; EN 60079-0:2018, EN 60079-1:2014, EN 60079-7:2015 + A1:2018, EN 60079-15:2017, EN 60079-31:2014

Jonathan Hitchens - Lead Certification Engineer - (Authorised Person)

CMP Products Limited, Cramlington, NE23 1WH, UK

EU Economic Operator: CMP Products Germany GmbH, Address: Lukasstraße 25a, 52070 Aachen
17th March 2020
2776
2503

Notified Body: CML B.V., Koopvaardijweg 32, 4906CV Oosterhout, The Netherlands

Approved Body: Eurofins E&E CML Limited, Newport Business Park, New Port Road, Ellesmere Port, CH65 4LZ

www.cmp-products.com

INSTALLATION INSTRUCTIONS FOR CMP CABLE GLAND TYPES T3CDSX

CABLE GLAND FOR USE WITH BRAID, STRIP AND TAPE ARMOUR FOR USE IN HAZARDOUS LOCATIONS.

CMP TRITON™ CDS™ DELUGE PROOF CABLE GLAND FEATURING COMPENSATING DISPLACEMENT SEAL SYSTEM.

INCORPORATING EU DECLARATION OF CONFORMITY TO DIRECTIVE 2014/34/EU AND UK STATUTORY REQUIREMENTS SI 2016 No. 1107 (AS AMENDED)



Number of Turns to Tighten	GLAND SIZE												
	20516	205	20	255	25	32	40	50S	50	63S	63	75S	75
CABLE DIAMETER													
0.5	13.2	15.9	20.9	22.0	26.2	33.9	40.4	46.7	52.8	59.2	65.9	72.1	78.5
1	12.5	15.3	20.0	21.2	25.4	32.9	40.4	46.7	52.8	59.2	65.9	72.1	78.5
1.5	11.9	14.7	19.0	20.4	24.6	31.9	39.0	45.4	51.4	57.7	64.6	70.6	77.2
2	11.2	14.2	18.1	19.6	23.8	30.8	37.6	44.1	50.0	56.2	63.4	69.2	75.9
2.5	10.5	13.6	17.2	18.8	23.0	29.8	36.2	42.9	48.7	54.7	62.1	67.7	74.6
3	9.8	13.0	16.2	18.0	22.2	28.8	34.8	41.6	47.3	53.2	60.9	66.3	73.3
3.5	9.2	12.4	15.3	17.2	21.4	27.8	33.5	40.3	45.9	51.6	59.6	64.8	71.9
4	8.5	11.8	14.4	16.4	20.6	26.8	32.1	39.0	44.5	50.1	58.4	63.4	70.6
4.5	7.8	11.2	13.4	15.6	19.8	25.7	30.7	37.8	43.2	48.6	57.1	61.9	69.3
5	7.1	10.7	12.5	14.8	19.0	24.7	29.3	36.5	41.8	47.1	55.9	60.5	68.0
5.5	6.5	10.1	12.0	14.0	18.2	23.7	27.9	35.2	40.4	45.6	54.6	59.0	66.7
6	5.8	9.5											

Refer to Cable gland selection table on changes for UL certified products

Cable Gland Selection Table

Cable Gland Size	Available Entry Threads (Alternate Metric Thread Lengths Available)					Cable Bedding Diameter	Overall Cable Diameter	Armour Range	Grooved Cone (X)	Across Flats	Across Corners	Protrusion Length	Combined Ordering Reference (*Brass Metric)	Shroud	Cable Gland Weight (Kgs)											
	Standard		Option																							
	Metric	Thread Length (Metric) "E"	NPT	Thread Length (NPT) "E"	NPT																					
20S/16	M20	15.0	1/2"	19.9	3/4"	3.1	8.6	6.1*	13.1	0.3	1.0	24.0	26.4	78.7	20516	T3CDSX	1RA	PVC36	0.20							
20S	M20	15.0	1/2"	19.9	3/4"	6.1	11.6	9.5	15.9	0.3	1.0	24.0	26.4	78.7	205	T3CDSX	1RA	PVC36	0.20							
20	M20	15.0	1/2"	19.9	3/4"	6.5	13.9	12.5	20.9	0.4	1.0	30.5	33.6	76.2	20	T3CDSX	1RA	PVC06	0.28							
25S/25	M25	15.0	3/4"	20.2	1"	11.1	19.9	14.0	22.0	0.4	1.2	37.5	41.3	88.8	25S	T3CDSX	1RA	PVC09	0.44							
25	M25	15.0	3/4"	20.2	1"	11.1	19.9	18.2	26.2	0.4	1.2	37.5	41.3	88.7	25	T3CDSX	1RA	PVC09	0.44							
32	M32	15.0	1"	25.0	1 1/4"	17.0	26.2	23.7	33.9	0.4	1.2	46.0	50.6	90.7	32	T3CDSX	1RA	PVC11	0.63							
40	M40	15.0	1 1/4"	25.6	1 1/2"	22.0	32.1	27.9	40.4	0.4	1.6	55.0	60.5	93.2	40	T3CDSX	1RA	PVC15	0.91							
50S/50	M50	15.0	1 1/2"	26.1	2"	29.5	38.1	35.2**	46.7	0.4	1.6	60.0	66.0	100.7	50S	T3CDSX	1RA	PVC18	1.12							
50	M50	15.0	2"	26.9	2 1/2"	35.6	44.0	40.4	53.0	0.6	1.6	70.1	77.1	105.8	50	T3CDSX	1RA	PVC21	1.60							
63S/63	M63	15.0	2"	26.9	2 1/2"	40.1	49.9	45.6	59.4	0.6	1.6	75.0	82.5	102.5	63S	T3CDSX	1RA	PVC23	1.73							
63	M63	15.0	2 1/2"	39.9	3"	47.2	55.9	54.6	65.8	0.6	1.6	80.0	88.0	105.4	63	T3CDSX	1RA	PVC25	1.78							
75S/75	M75	15.0	2 1/2"	39.9	3"	52.8	61.9	59.0	72.0	0.6	1.6	90.0	99.0	110.6	75S	T3CDSX	1RA	PVC28	2.57							
75	M75	15.0	3"	41.5	3 1/2"	59.1	67.9	66.7	78.4	0.6	1.6	100.0	110.0	120.3	75	T3CDSX	1RA	PVC30	3.33							
90	M90	24.0	3 1/2"	42.8	4"	66.6	78.6	76.2	90.3	0.8	1.6	115.0	126.5	138.9	90	T3CDSX	1RA	PVC32	4.87							
100	M100	24.0	3 1/2"	42.8	4"	76.0	90.9	86.1	101.4	0.8	1.6	127.0	139.7	128.2	100	T3CDSX	1RA	LSF33	4.97							
115	M115	24.0	4"	44.0	5"	86.0	97.9	101.5	110.2	0.8	1.6	138.0	151.8	161.3	115	T3CDSX	1RA	LSF34	7.72							
130	M130	24.0	5"	46.8	6"	97.0	114.9	110.2	123.2	0.8	1.6	157.0	172.7	173.7	130	T3CDSX	1RA	LSF35	9.78							

Dimensions are displayed in millimetres unless otherwise stated

Note: Standard Seal (Black) Temperature Range = -60°C to +130°C

High Temperature Seal (Brown) Temperature Range = -20°C to +200°C for High Temperature Seal add 'HT' to Ordering Reference after Gland Type e.g. 205T3CDSXHT1RA

Insert "PB" into the code for T3CDSXPB glands e.g. 20T3CDSXPB1RA


*Minimum cable allowable for a UL product is 7.0mm **Minimum cable allowable for a UL product is 38.0mm

Glasshouse Street • St. Peters • Newcastle upon Tyne • NE6 1BS
Tel: +44 191 265 7411 • Fax: +44 1670 715 646
E-Mail: customerservices@cmp-products.co.uk • Web: www.cmp-products.com


INSTALLATION INSTRUCTIONS FOR CMP CABLE GLAND T3CDSX

CABLE GLAND COMPONENTS - It is not necessary to dismantle the cable gland any further than illustrated below

1. Entry Item
2. Body
3. Compensating Sleeve
4. Braid Cone
5. AnyWay Clamping Ring
6. Outer Seal Nut

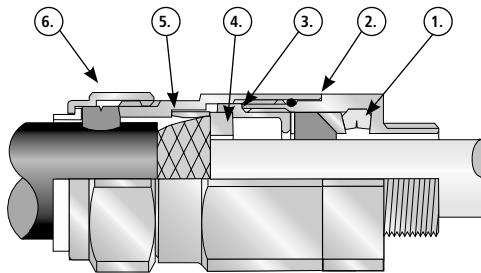


PLEASE READ ALL INSTRUCTIONS CAREFULLY BEFORE BEGINNING THE INSTALLATION

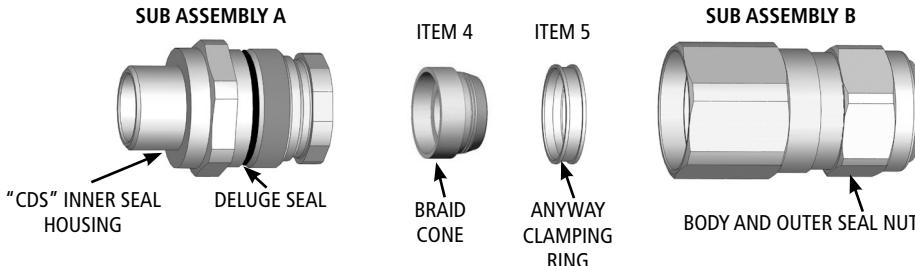

1. Separate the gland into two sub-assemblies, A and B, by unscrewing the body (2) from the entry item (1). Note that items (4) and (5) are loose items.


2. Prepare the cable by stripping back the cable outer sheath and armour to suit the equipment geometry. Expose the armour by stripping back the outer sheath further using the table below as a guide.

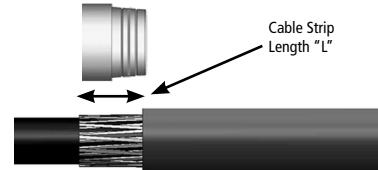


CABLE GLAND SIZE	20S/16, 20S, 20	25S, 25, 32, 40	50S, 50, 63S, 63	75S, 75, 90, 100, 115, 130
CABLE STRIP LENGTH "L"	12 mm (0.472 inches)	15 mm (0.591 inches)	18 mm (0.709 inches)	20 mm (0.787 inches)

3. Secure the entry components (sub-assembly A) into the equipment. (Not for remote installation)


When installing entry items that have an integrated o ring face seal via clearance/through holes, please refrain from rotating the entry item where possible. Hold the entry item stationary with the appropriate tool and tighten the locknut inside the enclosure to secure the gland.



4. Pass the cable through sub-assembly A, spacing the armour or braid evenly around the cone. Whilst continuing to push the cable forward to keep the cable braid or armour in contact with the cone, tighten the compensating sleeve (3) into the entry component (1) until all the threads are used. (Note that the internal compensator will prevent the cable gland inner seal from being overtightened onto the cable inner sheath.)

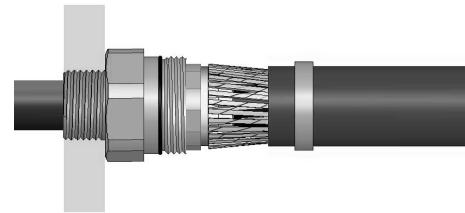

5. Terminate the cable by tightening the body (2) onto the entry component (1) using a spanner on each part. Tighten the body until the body and entry components are metal to metal and cannot be tightened further.

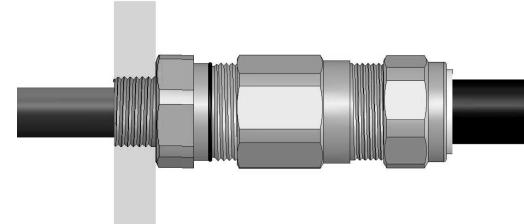

6. Only using finger pressure, tighten the outer seal nut assembly (8) until light resistance to tightening is met.

Then either use the outer seal tightening guide tape or table on the rear of the page to determine how much further to tighten the seal using a spanner (using the outer seal tightening guide is recommended).

Wrap the outer seal tightening guide tape around the cable to show the amount of spanner turns needed (as shown here). Make sure the correct side of the outer seal tightening guide tape is used depending on the cable gland size.

